

# CITY OF MADISON

CITY ENGINEERING DIVISION
DEPARTMENT OF PUBLIC WORKS
PLAN OF PROPOSED IMPROVEMENT

## PUBLIC IMPROVEMENT PROJECT APPROVED JANUARY 3, 2017

BY THE COMMON COUNCIL OF MADISON, WISCONSIN

PUBLIC IMPROVEMENT DESIGN APPROVED BY:

City Engineer

Date

#### INDEX OF SHEETS

SHEET NO. 1 TITLE
SHEET NO. D1 GENERAL NOTES
SHEET NO. D2 TYPICAL SECTION
SHEET NO. P1 STREET PLAN & PROFILE
SHEET NO. U1 SEWER PLAN & PROFILE
SHEET NO. U2 STORM SEWER SCHEDULE
SHEET NO. U3 SANITARY SEWER SCHEDULE
SHEET NO. WI WATER PLAN & PROFILE
SHEET NO. W2 WATER MATERIALS

GRANDVIEW COMMONS: PHASE 24

CITY PROJECT NO. 11505

MUNIS NO. 11505

CONTRACT NO. 7860



STORM SEWER BY:

SCONS

ERIC L.

DUNDEE


E-40126


SUN PRAIRIE


WI

04-12-2017

ONAL

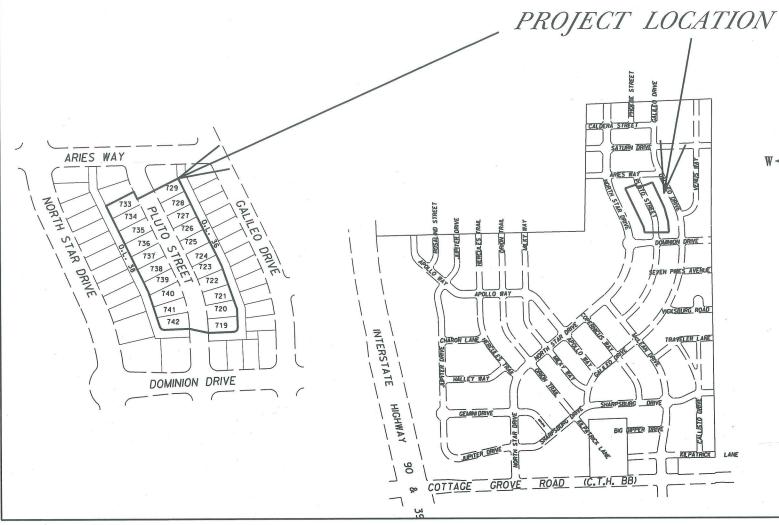

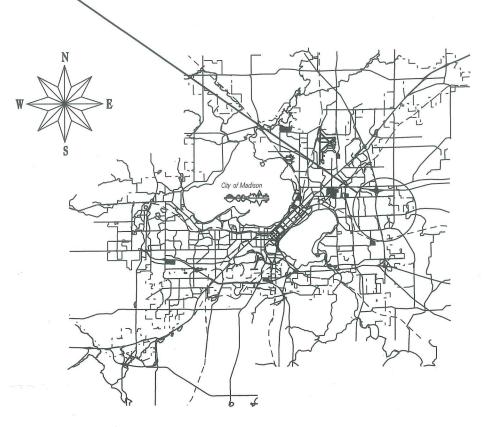



STREET DESIGNED BY:

SCONS

JOHN P.

SAPP

44054

Janesville,

WI-17

SONAL Eximination

NO TREES IN THE RIGHT OF WAY OR ON PUBLIC LANDS SHALL BE TRIMMED, PRUNED, REMOVED OR ADVERSELY AFFECTED IN ANY WAY UNTIL THE DEVELOPER HAS RECEIVED WRITTEN PERMISSION FROM THE CITY ENGINEER OR CITY FORESTER. SAID WRITTEN PERMISSION SHALL INCLUDE LANGUAGE INDICATING THAT SECTION 10.101 OF THE MADISON GENERAL ORDINANCES AND ADMINISTRATIVE PROCEDURE MEMORANDUM NO. 6–2, REFERING TO NOTIFICATION OF PROPERTY OCCUPANTS ANDOR OWNERS, HAS BEEN COMPLIED WITH.

CONVENTIONAL SIGNS						
FIELD VERIFY ALL UTIL	ITY LOCATIONS					
GAS	— с —					
STORM SEWER	st					
SANITARY SEWER	SAN					
WATER	—— w ——					
OVERHEAD ELECTRIC	—— ОН ———					
POWER POLE	ф					
ADA COMPLIANT RAMP DETECTABLE WARNING						
COMBUSTIBLE FLUIDS	< CAPARAS >					

ALL PAVEMENT IN THE PLUTO STREET RIGHT-OF-WAY SHALL BE TYPE A PAVEMENT PER STANDARD DETAIL DRAWING 4.02.

UNDERDRAINS SHALL BE INSTALLED, PER STANDARD DETAIL DRAWING 4.05 FOR 75'ON EACH SIDE OF THE LOW POINT, OR TO THE NEAREST CURB HIGH POINT. ALL UNDERDRAIN SHALL BE WRAPPED.

ALL GUTTERS SHALL DRAIN WITH A MINIMUM GRADES OF 0.5% TOWARD STORM SEWER INLETS.

ALL DITCHES SHALL DRAIN WITH A MINIMUM GRADES OF 0.5%

THE CROSS SLOPE OF SIDEWALKS AND BARRIER FREE SIDEWALK CURB
RAMPS SHALL BE 1.5%. THE LONGITUDINAL GRADE OF BARRIER
FREE SIDEWALK CURB RAMPS SHALL NOT EXCEED 8.33%. ALL SIDEWALK
RAMPS SHALL BE CONSTRUCTED ACCORDING TO S.D.D. 3.03. AT ALL
OTHER LOCATIONS THE LONGITUDINAL GRADE OF SIDEWALKS SHALL
NOT EXCEED 5.0 % OR THE ADJACENT STREET GRADE WHICHEVER
IS GREATER NOR BE LESS THAN 0.5% AND SHALL DRAIN TOWARD
STORM SEWER INLETS. SIDE SLOPES WITHIN TEN FEET OF A PUBLIC
SIDEWALK SHALL NOT EXCEED 4.00:1. ALL SIDEWALK AND SIDEWALK RAMP
ELEVATIONS AND GRADES SHALL BE FIELD VERIFIED AND SET TO COMPLY WITH
THE CITY OF MADISON STANDARD SPECIFICATIONS AND THE A.D.A. GUIDELINES.

OBTAIN A PRINT OUT OF THE ALIGNMENT FROM THE CITY ENGINEER PRIOR TO STAKING THIS PROJECT.

CURB STATION AND OFFSETS SHALL BE TO THE FACE OF CURB UNLESS OTHERWISE INDICATED. CURB ELEVATIONS SHALL BE TO THE TOP OF CURB (OR EXTENDED TOP OF CURB FOR DRIVEWAYS OR RAMPS) UNLESS OTHERWISE INDICATED.

POWER POLES AND OTHER OBSTRUCTIONS SHALL BE MOVED TO PROVIDE 2 FEET MINIMUM OF CLEAR DISTANCE FROM ANY FACE OF CURB OR EDGE OF SIDEWALK.

ANY INFORMATION SHOWN ON THIS PLAN, WHICH IS NOT PART OF THIS PROJECT, IS PRELIMINARY AND NOT FOR CONSTRUCTION.

THERE MAY BE EXISTING UTILITIES OR OTHER FEATURES WHICH ARE EITHER NOT SHOWN OR SHOWN INCORRECTLY ON THIS PLAN. IT IS THE RESPONSIBILITY OF THE DEVELOPER TO LOCATE AND IDENTIFY ALL UTILITIES AND TOPOGRAPHY WHICH MAY AFFECT THE CONSTRUCTION OF THESE IMPROVEMENTS.

ALL PERMANENT SIGNING AND POSTING WILL BE DETERMINED AND PROVIDED BY THE TRAFFIC ENGINEERING DIVISION, FOLLOWING CONSTRUCTION OF THESE IMPROVEMENTS.

THE DEVELOPER SHALL PROVIDE, INSTALL AND MAINTAIN ALL STREET END BARRICADES, SIGNING AND TRAFFIC CONTROL, AS REQUIRED BY THE CITY TRAFFIC ENGINEER.

PAVEMENT SAWCUTS SHALL BE AS DIRECTED BY THE CITY CONSTRUCTION ENGINEER. SAWCUTS SHOWN ON THE PLAN

CURB ON CUL DE SACS SHALL BE INSTALLED ACCORDING TO SDD 3.05.

GRANDVIEW COMMONS PH. 24 PROJECT NO. 10505 SHEET NO. D-1

DETAIL

STANDARD NOTES AND COMMENTS

CITY OF MADISON


OBIGINATOR: CITY OF MADISON STREETS DIVISION

GRANDVIEW COMMONS PH. 24 SHEET NO. D-2

DETAIL

TYPICAL SECTION

CITY OF MADISON

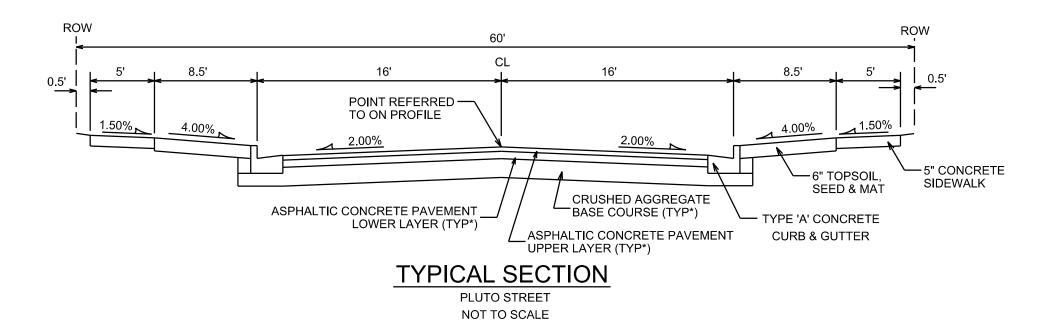

#### CITY OF MADISON MINIMUM PAVEMENT DESIGN

	CRUSHED AGG. BASE COURSE   ASPHALTIC CONCRETE PAVE					
TYPE	LOWER LAYER					
	GRADATION 1	GRADATION 2	TYPE	THICKNESS	TYPE	THICKNESS
Α	6"	4"	E-0.3	1.75"	E-0.3	1.75"
В	6"	4"	E-1	2.25"	E-1	2"
С	6"	4"	E-3	3.25"	E-3	2"

#### NOTES:

\* PLUTO STREET SHALL BE CONSTRUCTED AS TYPE 'A' PAVEMENT PER CITY OF MADISON MINIMUM PAVEMENT DESIGN

SANITARY SEWER SCHEDULE

GRANDVIEW COMMONS PH. 24 PROJECT NO. 11505 SHEET NO. U-2

ROJECT NO. 11505

CITY OF MADISON

SANITARY SEWER SCHEDULE

ALIGNMENT CODES:
'PS' = PLUTO STREET

**PROPOSED SANITARY STRUCTURES** 

DEPTH NOTES SAS LOCATION TOP OF NO. (OFFSET) CASTING 22'PS'+50.56 CL SAS#1 967.12 956.86 10.26 21'PS'+38.48 RT-1.43 SAS#2 967.69 957.41 10.28

PROPOSED SANITARY PIPES

FROM (DNSTM)	TO (UPSTM)	DWNSTRM E.I.	UPSTRM E.I.	PLAN LGTH (FT)	SLOPE (%)	PIPE SIZE	PVC TYPE	NOTES
EX SAS7342-018	SAS#1	955.63	956.86	309	0.40%	8"	SDR-35	-
SAS#1	SAS#2	956.96	957.41	112	0.40%	8"	SDR-35	-

### STORM SEWER SCHEDULE

GRANDVIEW COMMONS PHASE 24 SHEET NO.
PROJECT NO. 11505 U-3
STORM SEWER SCHEDULE

CITY OF MADISON

<u>PROP</u>	POSED STO	<u>RM STRUC</u>	TURES					PROPOSED STORM PIPES									
STRUC. NO.	STATION	LOCATION (OFFSET)	TYPE	TOP OF CASTING	E.I.	DEPTH	NOTES	PIPE NO.	FROM (DNSTM)	TO (UPSTM)	DISCH. E.I.	INLET E.I.	PLAN LGTH (FT)	SLOPE (%)	PIPE SIZE	TYPE	NOTES
PLUTO S		LT 45 50	CONCRETE COLLAR		057.50			D.4	C 4	6.2	057.52	000.40	420	0.000/	CO!!	DOD	(4)
S-1	25+64.28	LT-15.50	CONCRETE COLLAR	-	957.52	-	-	P-1	S-1	S-2	957.52	960.49	436	0.68%	60"	RCP	(1)
S-2	21+22.33	LT-10.64	FIELD BEND	-	960.49	-	-										

#### **SPECIFIC NOTES**

(1) MAC WRAP JOINTS TO BEND PIPE UNDER CURB FOR APPROXIMATELY LAST 150FT

#### STANDARD NOTES:

- ABBREVIATIONS: AE = APRON ENDWALL; RCP = REINFORCED CONCRETE PIPE; HERCP = HORIZONTAL ELLIPTICAL REINFORCED CONCRETE PIPE; DNA = DOES NOT APPLY; SAS = SEWER ACCESS STRUCTURE; LP = LOW POINT INLET STRUCTURE; FP = FIELD POURED STRUCTURE; TR = TOP OF CONCRETE ROOF; NCM = NO CROWN MATCH FOR PIPES; UD = UNDERDRAIN
- APPROXIMATE DISCHARGE E.I. GIVEN, ADJUST E.I. AND PIPE SLOPE IN THE FIELD.
- TOP OF CASTING GRADE GIVEN IS THE TOP OF CURB FOR INLET STRUCTURES AND THE FLOWLINE OF THE CLOSED CASTING FOR SAS's.
- TOP OF CONCRETE ROOF (TR) IS 1.25' BELOW TOP OF CASTING UNLESS OTHERWISE NOTED.
- ALL REINFORCED CONCRETE PIPES TO BE CLASS III UNLESS OTHERWISE NOTED.
- SURVEYOR TO CONFIRM THAT ALL INLET STATION / OFFSETS LINE UP WITH PROPOSED CURB AND GUTTER.
- ALL STRUCTURES CALLED OUT AS FIELD POURED SHALL BE FIELD POURED. ALL OTHER STRUCTURES (NOT INDICATED AS FIELD POURED) SHALL BE SUBMITTED TO CITY ENGINEERING FOR APPROVAL IF PRECAST STRUCTURES ARE PREFERRED. CONTACT ELIA E. ACOSTA OF CITY ENGINEERING AT (608) 266-4096 FOR PRECAST APPROVALS, FAX SHOP DRAWINGS TO (608)264-9275, OR EMAIL SHOP DRAWINGS TO EACOSTA@CITYOFMADISON.COM.

- VERIFY SIZE OF EXISTING
   WATER SERVICES AND RECONNECT SERVICES
   AS INDICATED.
- 3. MINIMIZE DISRUPTION OF SERVICE TO EXISTING CUSTOMERS. NOTIFY PER CONTRACT REQUIREMENTS OF ANY PLANNED WATER OUTAGE.
- 4. THE EXISTING UTILITIES SHOWN ON THIS PLAN REPRESENT THE BEST INFORMATION AVAILABLE TO THE WATER UTILITY AT THE TIME OF PLAN PREPARATION. CONTRACTOR IS RESPONSIBLE FOR HAVING EACH UTILITY LOCATED PRIOR TO COMMENCING WORK.



- WN1 REPLACE THE EXISTING LEAD SERVICE WITH A NEW COPPER SERVICE.
- WN2 EXTEND AND RECONNECT THE EXISTING COPPER SERVICE TO THE NEW WATER MAIN.
- WN3 EXISTING SERVICE TO BE ABANDONED WHEN THE WATER MAIN IS CUT OFF.
- WN4 DISCONNECT FROM THE OLD WATER MAIN AND RECONNECT THE EXISTING COPPER WATER SERVICE LATERAL TO THE NEW WATER MAIN.
- WN5 RELOCATE THE EXISTING FIRE HYDRANT.
- WN6 ABANDON WATER VALVE ACCESS STRUCTURE.
- WN7 FURNISH AND INSTALL THE NEW TOP SECTION FOR THE WATER ACCESS STRUCTURE.
- WN8 ABANDON THE VALVE BOX.
- WN9 FURNISH THE DITCH, COMPACTION, AND ALL MATERIALS AND LABOR FOR THE INSTALLATION OF NEW SERVICE LATERAL.
- WN10 REMOVE AND SALVAGE EXISTING HYDRANT
- WN11 REPLACE THE EXISTING COPPER SERVICE WITH A COPPER SERVICE

#### **ESTIMATE OF PROJECT WATER MATERIALS:**

\* ESTIMATE OF MATERIALS IS FOR INFORMATION ONLY. ENGINEER DOES NOT GUARANTEE ACCURACY OF MATERIAL TAKE-OFF. ALWAYS REFER TO PLANS.

15
460
530
1
1
1

REUSED MATERIALS	
5-IN HYDRANTS	1

SALVAGED MATERIALS	
5-IN HYDRANTS	1
8-IN X 6-IN TEES	1
8-IN MJ PLUGS	1
8-IN X 6-IN REDUCERS	1

MISC. MATERIALS	
INSULATION (LF)	AS REQ
COPPER TUBING (1-IN)	AS REQ

TO OBTAIN LOCATION OF PARTICIPANTS' UNDERGROUND FACILITIES BEFORE YOU DIG IN WISCONSIN

CALL DIGGERS HOTLINE
TOLL FREE
811 OR 1-800-242-8511
FAX-A-LOCATE 1-800-338-3860
TDD (FOR HEARING IMPAIRED) 1-800-542-2289

WIS. STATUTE 182.0175 (1974) REQUIRES MIN. OF 3 WORK DAYS NOTICE BEFORE YOU EXCAVATE.



DISCLAIMER NOTE:
UTILITY LOCATIONS SHOWN ARE APPROXIMATE
ONLY. IT SHALL BE THE CONTRACTOR'S
RESPONSIBILITY TO DETERMINE THE EXACT
HORIZONTAL AND VERTICAL LOCATION OF ALL
EXISTING UNDERGROUND AND OVERHEAD
UTILITIES PRIOR TO COMMENCING WORK.

SHEET NO. W-2

WATER ESTIMATE OF MATERIALS

CITY OF MADISON

