TITLE

DETAILS

DAYTON & BASSETT SIDEWALK

CITY ENGINEERING DIVISION DEPARTMENT OF PUBLIC WORKS PLAN OF PROPOSED IMPROVEMENT

CITY OF MADISON

202–210 N. BASSETT STREET PUD


CITY PROJECT NO. 53B2333 CONTRACT NO. 2333


CONVENTIONAL SIGNS FIELD VERIFY ALL UTILITY LOCATIONS STORM SEWER SANITARY SEWER WATEROVERHEAD ELECTRIC POWER POLE ADA COMPLIANT RAMP W DETECTABLE WARNING FIELD COMBUSTIBLE FLUIDS

CONSTRUCTION PROJECT LOCATION

ALL GUTTERS SHALL DRAIN WITH A MINIMUM GRADE OF 0.50% TOWARD STORM SEWER INLETS.

SIDEWALK RAMPS AND CURB THRU SIDEWALK RAMPS SHALL HAVE A MAXIMUM SLOPE OF 1" PER 12". SIDEWALK AND CURB RAMPS SHALL BE CONSTRUCTED WITH A SIDE SLOPE OF 2.00%. SIDEWALK SHALL HAVE A MINIMUM LONGITUDINAL SLOPE OF 0.50% AND A MAXIMUM LONGITUDINAL SLOPE OF 5.00% EXCEPT WHERE STREET GRADES EXCEED 5.00%.

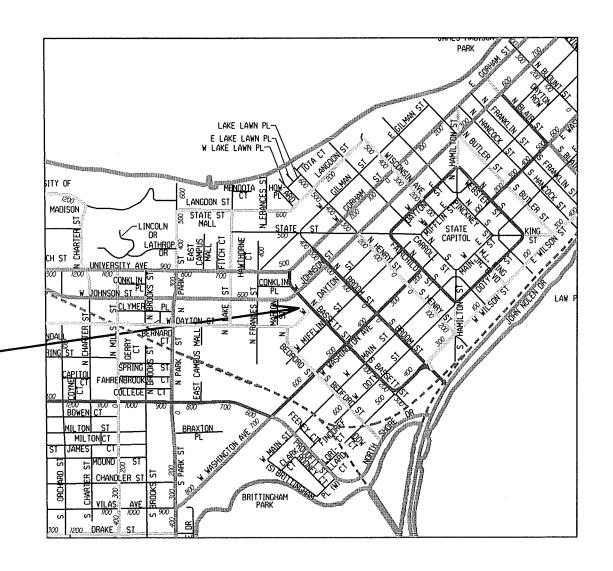



PUBLIC IMPROVEMENT PROJECT APPROVED

MAY 7, 2013


BY THE COMMON COUNCIL OF MADISON, WISCONSIN

PUBLIC IMPROVEMENT DESIGN APPROVED BY:

STORM & SANITARY SEWER DESIGNED BY:

LATERALS ABANDONMENTS

ELECTRICAL DESIGNED BY



THE LOCATION AND INFORMATION FOR PROPOSED NEW TREES, IN THE PUBLIC RIGHT OF WAY OR ON PUBLIC LANDS ARE APPROXIMATE AND ARE SHOWN FOR REFERENCE ONLY. THE LOCATIONS, SPECIFICATIONS AND PLANTING METHODS OF ALL PROPOSED NEW OR REPLACEMENT TREES IN THE PUBLIC RIGHT OF WAY OR ON PUBLIC LANDS SHALL BE APPROVED BY THE CITY FORESTER PRIOR TO INSTALLATION.

NO TREES IN THE RIGHT OF WAY OR ON PUBLIC LANDS SHALL BE TRIMMED, PRUNED, REMOVED OR ADVERSELY AFFECTED IN ANY WAY UNTIL THE DEVELOPER HAS RECEIVED WRITTEN PERMISSION FROM THE CITY ENGINEER OR CITY FORESTER. SAID WRITTEN PERMISSION SHALL INCLUDE LANGUAGE INDICATING THAT SECTION 10.101 OF THE MADISON GENERAL ORDINANCES AND ADMINISTRATIVE PROCEDURE MEMORANDUM NO. 6–2, REFERING TO NOTIFICATION OF PROPERTY OCCUPANTS AND/OR OWNERS, HAS BEEN COMPLIED WITH.

THE DEVELOPERCONTRACTOR SHALL SUBMIT A TRAFFIC CONTROL PLAN FOR REVIEW TO CITY TRAFFIC ENGINEERING AT LEAST 10 WORKING DAYS PRIOR TO WORK BEGINNING WITHIN THE RIGHT OF WAY. WORK SHALL NOT PROCEED IN THE RIGHT OF WAY UNTIL THE TRAFFIC CONTROL PLAN HAS BEEN APPROVED. THE TRAFFIC CONTROL PLAN MAY INCLUDE BUT IS NOT LIMITED TO: LANE CLOSURE RESTRICTIONS, PEAK HOUR WORKING RESTRICTIONS, ACCESS REQUIREMENTS, ETC. THE DEVELOPERCONTRACTOR SHALL BE RESPONSIBLE FOR PHASING WORK AS NECESSARY TO MEET THE REQUIREMENTS OF THE APPROVED TRAFFIC CONTROL PLAN.

THE DEVELOPER/CONTRACTOR SHALL CONTACT CITY FORESTRY (DEAN KAHL 266–4891 OR 266–4816) PRIOR TO EXCAVATING WITHIN 5 FT. OF AN EXISTING TREE SO THAT THEY MAY PROVIDE DIRECTION ON THE WORK. THE DEVELOPER/CONTRACTOR SHALL ALSO CONTACT CITY FORESTRY AT LEAST ONE WEEK PRIOR TO ANY TREE REMOVALS OR PRUNING TO OBTAIN A PERMIT FOR TREE REMOVAL OR PRUNING WITHIN THE RIGHT-OF-WAY.

CONTRACTOR SHALL INSTALL TREE TYPES SPECIFIED AT APPROX. LOCATIONS SHOWN WITHIN THE TERRACE OF N. BASSETT STREET & WEST DAYTON STREET. CONTRACTOR SHALL CONTACT DEAN KAHL WITH CITY FORESTRY (266-4891 OR 266-4816) AT LEAST ONE WEEK PRIOR TO PLANTING TO ALLOW FORESTRY TO MARK THE PLANTING SITES AND REVIEW PLANTING SPECIFICATIONS WITH THE LANDSCAPING CONTRACTOR.

ALL PAVEMENT IN THE DAYTON ST. & BASSETT ST. RIGHT-OF-WAYS SHALL
BE TYPE C PAVEMENT. BASSETT STREET PAVEMENT RATING IS 6 AND
DAYTON STREET PAVEMENT RATING IS 8. SAWCUTS, PATCHING & MILL & OVERLAY
LIMITS SHOWN ARE APPROXIMATE - LIMITS SHALL BE AT THE DISCRETION
OF THE CONSTRUCTION ENGINEER & IN ACCORDANCE WITH CITY OF MADISON
PATCHING CRITERIA.

ISLAND INTERIORS SHALL BE OF SOD WHERE THE BACK TO BACK OF CURB DIMENSION IS GREATER THAN 6'.

UNDERDRAINS SHALL BE INSTALLED, PER STANDARD DETAIL DRAWING 4.05 FOR 75'ON EACH SIDE OF THE LOW POINT, OR TO THE NEAREST CURB HIGH POINT. ALL UNDERDRAIN SHALL BE WRAPPED.

ALL GUTTERS SHALL DRAIN WITH A MINIMUM GRADES OF 0.5% TOWARD STORM SEWER INLETS.

PAVEMENT CROSS SLOPES SHALL BE 2%, TERRACES SHALL SLOPE AT A 4% GRADE TOWARD THE GUTTER, SHOULDERS SHALL HAVE A 4% CROSS SLOPE AND CROSS SLOPES FORMING DITCHES SHALL NOT EXCEED 4.00:1 UNLESS OTHERWISE INDICATED.

THE CROSS SLOPE OF SIDEWALKS AND BARRIER FREE SIDEWALK CURB
RAMPS SHALL BE 2%. THE LONGITUDINAL GRADE OF BARRIER
FREE SIDEWALK CURB RAMPS SHALL NOT EXCEED 8.33%. ALL SIDEWALK
RAMPS SHALL BE CONSTRUCTED ACCORDING TO S.D.D. 3.03. AT ALL
OTHER LOCATIONS THE LONGITUDINAL GRADE OF SIDEWALKS SHALL
NOT EXCEED 5.0 % OR THE ADJACENT STREET GRADE WHICHEVER
IS GREATER NOR BE LESS THAN 0.5% AND SHALL DRAIN TOWARD
STORM SEWER INLETS. A 2 FOOT WIDE CONCRETE FLUME SHALL BE
INSTALLED BETWEEN THE SIDEWALK AND THE BACK OF CURB AT
SIDEWALK LOW POINTS WHICH CANNOT OTHERWISE BE DRAINED DIRECTLY
TO THE GUTTER. SIDE SLOPES WITHIN TEN FEET OF A PUBLIC
SIDEWALK SHALL NOT EXCEED 4.00:1. ALL SIDEWALK AND SIDEWALK RAMP
ELEVATIONS AND GRADES SHALL BE FIELD VERIFIED AND SET TO COMPLY WITH
THE CITY OF MADISON STANDARD SPECIFICATIONS AND THE A.D.A. GUIDELINES.

OBTAIN A PRINT OUT OF THE ALIGNMENT FROM THE CITY ENGINEER PRIOR TO STAKING THIS PROJECT.

CURB STATION AND OFFSETS SHALL BE TO THE FACE OF CURB UNLESS OTHERWISE INDICATED. CURB ELEVATIONS SHALL BE TO THE TOP OF CURB (OR EXTENDED TOP OF CURB FOR DRIVEWAYS OR RAMPS) UNLESS OTHERWISE INDICATED.

POWER POLES AND OTHER OBSTRUCTIONS SHALL BE MOVED TO PROVIDE 2 FEET MINIMUM OF CLEAR DISTANCE FROM ANY FACE OF CURB OR EDGE OF SIDEWALK.

ANY INFORMATION SHOWN ON THIS PLAN, WHICH IS NOT PART OF THIS PROJECT, IS PRELIMINARY AND NOT FOR CONSTRUCTION.

THERE MAY BE EXISTING UTILITIES OR OTHER FEATURES WHICH ARE EITHER NOT SHOWN OR SHOWN INCORRECTLY ON THIS PLAN. IT IS THE RESPONSIBILITY OF THE DEVELOPER TO LOCATE AND IDENTIFY ALL UTILITIES AND TOPOGRAPHY WHICH MAY AFFECT THE CONSTRUCTION OF THESE IMPROVEMENTS.

ALL PERMANENT SIGNING AND POSTING WILL BE DETERMINED AND PROVIDED BY THE TRAFFIC ENGINEERING DIVISION, FOLLOWING CONSTRUCTION OF THESE IMPROVEMENTS.

THE DEVELOPER SHALL PROVIDE, INSTALL AND MAINTAIN ALL STREET END BARRICADES, SIGNING AND TRAFFIC CONTROL, AS REQUIRED BY THE CITY TRAFFIC ENGINEER.

PAVEMENT SAWCUTS SHALL BE AS DIRECTED BY THE CITY CONSTRUCTION ENGINEER. SAWCUTS SHOWN ON THE PLAN ARE APPROXIMATE.

CURB ON CUL DE SACS SHALL BE INSTALLED ACCORDING TO SDD 3.05.

313-315 N. FRANCES STREET PUD PROJECT NO. 53B2332 SHEET NO. D-1

PLAN

STANDARD NOTES AND COMMENTS

CITY OF MADISON

1) REFERENCE LINE AND/OR POINT REFERRED TO ON PROFILE (2) 5" OR 7" CONCRETE SIDEWALK ③ TYPE 'A' CONCRETE CURB & GUTTER (4) 4" TOPSOIL, SEED & MAT (5) 2" UPPER LAYER BIT PVMT, 12.5 mm, TYPE E-3 (6) 3.25" LOWER LAYER BIT PVMT, 19 mm, TYPE E-3 (7) GRADATION 2 CRUSHED AGG BASE COURSE, 4" TYP. (8) GRADATION 1 CRUSHED AGG BASE COURSE, 6" TYP (9) TYPE 'H' CONCRETE CURB & GUTTER


5' 3" _____ 7.5' TYP 1' TYP. — **VARIES** TYPICAL FINISHED SECTION N. BASSETT STREET NTS

TYPICAL SECTIONS CITY OF MADISON

SHEET NO. D-2

202-210 N. BASSETT STREET PUD PROJECT NO. 53B2333

DETAILS

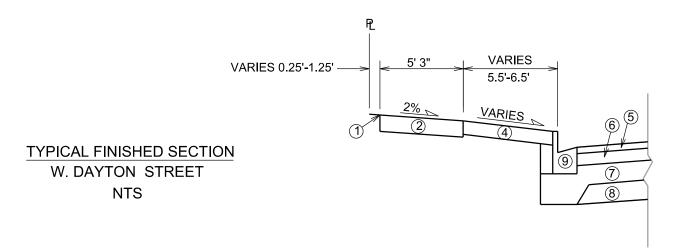

FILE NAME: M:\DESIGN\Projects\53B2333\Streets\Design\TypSec_Details.dgn

DATE: 8/23/2013

